


CURVING DETAIL

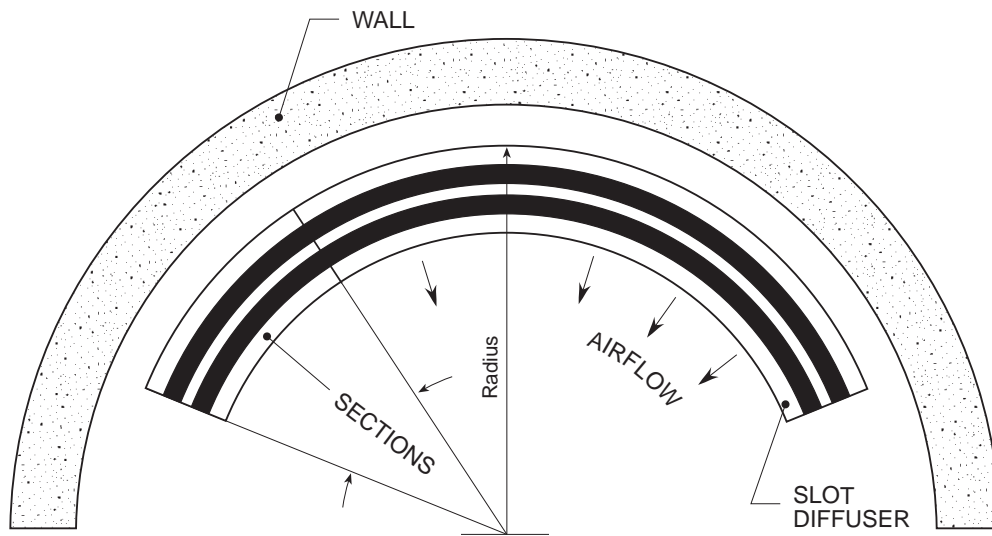

NOTE:

1. Measure ceiling, sidewall and barrel bends in the same fashion.
2. Deflector shall be installed prior to final assembly.
3. Radiused sections shall be field trimmed by the contractor to assure a proper fit for their particular applications.
4. Radiused sections available in 3/4, 1, 1-1/2, and 2 inches LT frame and CS frame. Multiple slots available.
5. When ordering curved linear provide a radius and where it is measured to (outside flange, inside flange) Also provide the circumference of the linear.
(Circumference = 3.1416 x Diameter)
6. Curved linear can be adjusted by loosening the side screws and placing the curve into position and retightening the screws.